




# BURBANK SANITARY DISTRICT

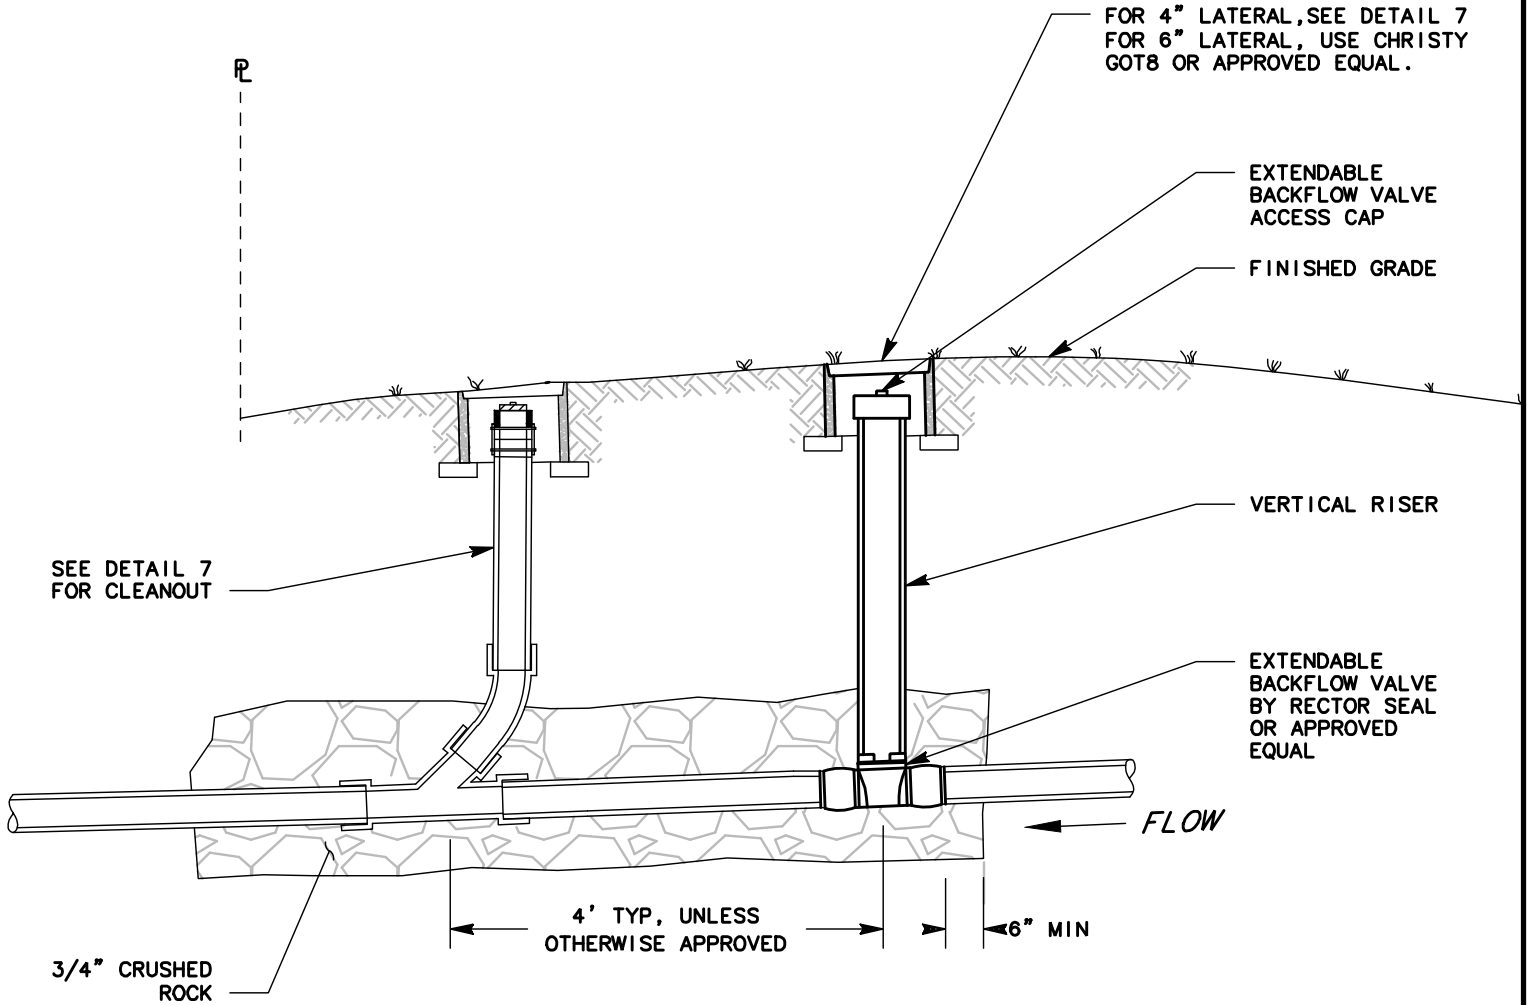

## NOTES:

1. A BACKFLOW PREVENTER DEVICE IS REQUIRED WHEN THE ELEVATION OF THE LOWEST FINISHED FLOOR WITH PLUMBING IS LESS THAN 12" ABOVE THE NEAREST UPSTREAM MANHOLE OR FLUSHING INLET
2. ALL CLEANOUTS AND BACKFLOW DEVICES ARE TO BE MAINTAINED BY PROPERTY OWNER
3. ALL BACKFLOW DEVICES ARE TO BE ACCESSIBLE FOR LATERAL SEWER MAINTENANCE
4. PLACARD SHALL BE PLACED IN THE UPSTREAM CLEANOUT BOX CLOSEST TO THE HOUSE WARNING PLUMBERS OF THE EXTENDABLE BACKWATER VALVE

## BACKFLOW PREVENTER DEVICE

DETAIL **8**

DR. BY: ED  
DATE: 06/01/2020

CK. BY: FQ  
DATE: 06/01/2020

APPROVED. BY:

DATE: 06/01/2020